

Date		Project	
Type		Part Number	



APEX Series

ECO Linear Highbay

ORDERING INFORMATION

Order Code	R34144
Model Number	RENO-LHB-DV-MW-MCCT-R4-ECO
Case Quantity	1
DLC / Energy Star ID	Pending



PHYSICAL DATA

Dimensions	22.99" x 12.6" x 2.7" (58.39 cm x 32.00 cm x 6.85 cm)
Lens / Diffuser	Polycarbonate
Case / Housing	Powder-Coated Die-Cast Aluminum (White)
Mounting Type(s)	Suspended, Surface mounted, Pendant


PERFORMANCE DATA

Wattage	260/280/320W
Voltage	120-347V AC
CCT	35/40/5000K (Typical range+/-5%)
Lumen	37,440-48,640 lm
Efficacy	139-155 lm/W
CRI	80+
Lifespan	L70 100,000 hrs, INESA LM-80 testing report: 9,000 hrs (INESA TM-21 extrapolations)
Dimming	0-10V
Power Factor	>0.9
THD	20%
Surge Protection	10
Operating Temperature	-40°C ~ +55°C (-40°F ~ +131°F) - See table for more details

Wattage	3500K		4000K		5000K		Voltage
	Lumens	Efficacy	Lumens	Efficacy	Lumens	Efficacy	
260W	37,440 lm	144 lm/W	40,300 lm	155 lm/W	38,480 lm	148 lm/W	120-347V
280W	39,760 lm	142 lm/W	43,120 lm	154 lm/W	40,880 lm	146 lm/W	120-347V
320W	44,480 lm	139 lm/W	48,640 lm	152 lm/W	47,040 lm	147 lm/W	120-347V

DIMENSIONS

Width: 12.6" (320 mm)
 Height: 2.7" (68.65 mm)
 Length: 22.99" (584 mm)
 Weight: 15.4 lbs (7 kg)

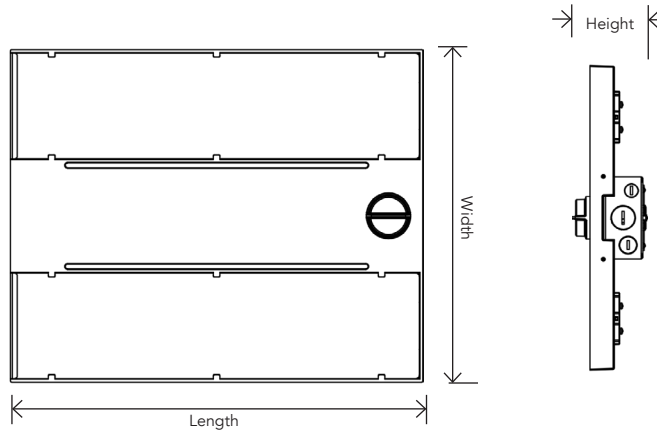

ACCESSORIES

Order#	Name / Description
R39336	40° x 90° Lens for R3/R4 Highbay (2pcs/set)
R39339	65° x 65° Lens for R3/R4 Highbay (2pcs/set)
R39342	110° x 110° Lens for R3/R4 Highbay (2pcs/set)
R39343	Pendant Mount Kit
R39344	Surface Mount Kit
R39333	Wire Guard for R3/R4 Highbay
R83003	External Mount Emergency Driver, 40W Output, ≥90 Minutes Operating Time
R83012	Fixture-Mounted Junction Box for Emergency Battery

STANDALONE SENSORS

Order#	Name / Description
R71002	Bi-level Microwave Sensor
R74004	Long Detection Range PIR Sensor
R73002	Remote Control for Standalone Sensors (With Screen) Note: Only 1 needed per project.
R74004	Remote Control for Standalone Sensors (Without Screen) Note: Only 1 needed per project.

RENO SMART ACCESSORIES

Order#	Name / Description
R75001	Bluetooth 3.5mm Jack PIR Sensor for RENO Smart NLC System
R75002	Bluetooth 3.5mm Jack Microwave Sensor for RENO Smart NLC System
R75201	Ceiling Mounted Gateway for RENO Smart NLC System
R75302	7-Key Smart Wall Switch for RENO Smart NLC System
R75301	5-Key Reset Remote Controller


****All Reno Smart Sensors are programmed/commissioned using our Reno Smart App**

RENO-LHB-DV-MW-MCCT-R4-ECO | INDIVIDUAL SPECSHEET

PHOTOMETRICS

260W	4000K	38,919 lm
------	-------	-----------

LUMINOUS INTENSITY DISTRIBUTION

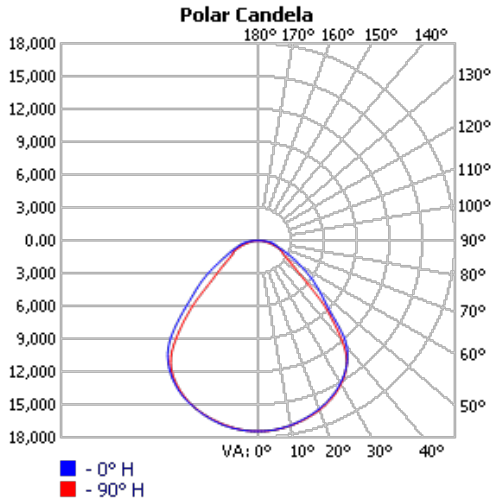

ZONAL LUMEN SUMMARY

Zone	Lumen	% Fixture
0-30	13,711.0	35.2
0-40	22,438.8	57.6
0-60	33,933.3	87.2
60-90	4,986.6	12.8
0-90	38,919.9	100

ILLUMINANCE AT A DISTANCE


Height	Center Beam fc	Beam Width (V / H)
4.0 ft	1,090.19 fc	8.7 / 8.0 ft
8.0 ft	272.55 fc	17.3 / 15.9 ft
12.0 ft	121.13 fc	23.9 / 26.0 ft
16.0 ft	68.14 fc	31.9 / 34.7 ft
20.0 ft	43.61 fc	39.9 / 43.3 ft

Vertical Spread: 94.6° | Horizontal Spread: 89.8°

See IES Files for details.

280W	4000K	41,576 lm
------	-------	-----------

LUMINOUS INTENSITY DISTRIBUTION

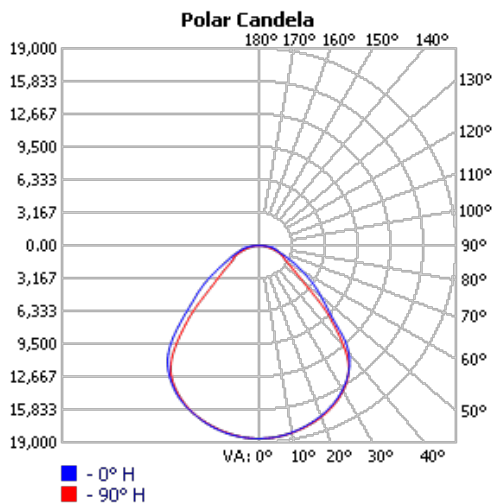

ZONAL LUMEN SUMMARY

Zone	Lumen	% Fixture
0-30	14,647.3	35.2
0-40	23,972.4	57.6
0-60	36,252.3	87.2
60-90	5,323.7	12.8
0-90	41,576.0	100

ILLUMINANCE AT A DISTANCE

Height	Center Beam fc	Beam Width (V / H)
4.0 ft	1,090.19 fc	8.7 / 8.0 ft
8.0 ft	272.55 fc	17.3 / 15.9 ft
12.0 ft	121.13 fc	23.9 / 26.0 ft
16.0 ft	68.14 fc	31.9 / 34.7 ft
20.0 ft	43.61 fc	39.9 / 43.3 ft


Vertical Spread: 94.6° | Horizontal Spread: 89.8°

See IES Files for details.

PHOTOMETRICS (CONTINUED)

320W	4000K	46,596 lm
------	-------	-----------

LUMINOUS INTENSITY DISTRIBUTION

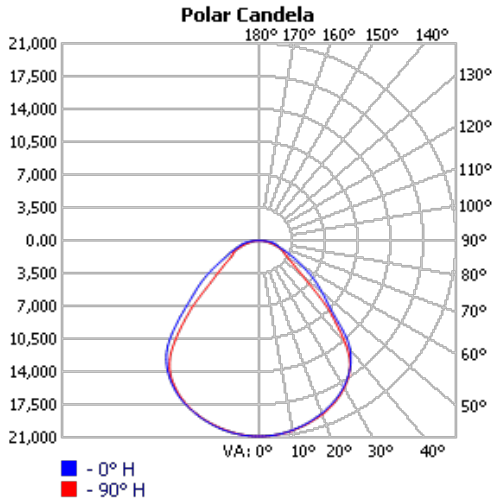

ZONAL LUMEN SUMMARY

Zone	Lumen	% Fixture
0-30	16,418.8	35.2
0-40	26,872.8	57.6
0-60	40,634.4	87.2
60-90	5,962.2	12.8
0-90	46,596.6	100

ILLUMINANCE AT A DISTANCE

Height	Center Beam fc	Beam Width (V / H)
4.0 ft	1,305.50 fc	8.7 / 8.0 ft
8.0 ft	326.38 fc	17.3 / 15.9 ft
12.0 ft	145.06 fc	23.9 / 26.0 ft
16.0 ft	81.59 fc	31.9 / 34.7 ft
20.0 ft	52.22 fc	39.9 / 43.3 ft

Vertical Spread: 94.6° | Horizontal Spread: 89.8°

See IES Files for details.

SPECIFIER CONFIRMATION

Order#	Quantity	Price
--------	----------	-------

I accept the specifications of the luminaire configuration.

Signature	Company
Name	Date